

A T Design
 34 Alexandra Gardens
 Knaphill
 Woking
 Surrey
 GU21 2DG

M: 07411 235088
 E: a-t-design@outlook.com

BS 5839-1:2017 Fire detection and fire alarm systems for buildings
 Part 1: Code of practice for design, installation, commissioning,
 and maintenance of systems in non-domestic premises.

BS 5839-2:1983 Fire detection and alarm systems for buildings
 Part 2: Specification for manual call points

BS 5266-1:2016 Emergency lighting
 Part 1: Code of practice for the emergency lighting of premises









BS 5499-4:2013 Safety signs
 Part 4: Code of practice for escape route signing


BS 5499-5:2002 Graphical symbols and signs
 Part 5: Safety signs, including fire safety signs

BS EN 14604:2005 Smoke alarm devices

BS 7671:2018 Requirements for Electrical Installations.
 IET Wiring Regulations 18th Edition

Approved Document B (fire safety) volume 2:
 Buildings other than dwellings,
 2019 edition incorporating 2020 and 2022 amendments

-  alarm sound/light
-  fire call-point
-  fire extinguisher
-  small emergency light
-  large emergency light
-  smoke detector
-  heat detector
-  CCTV camera

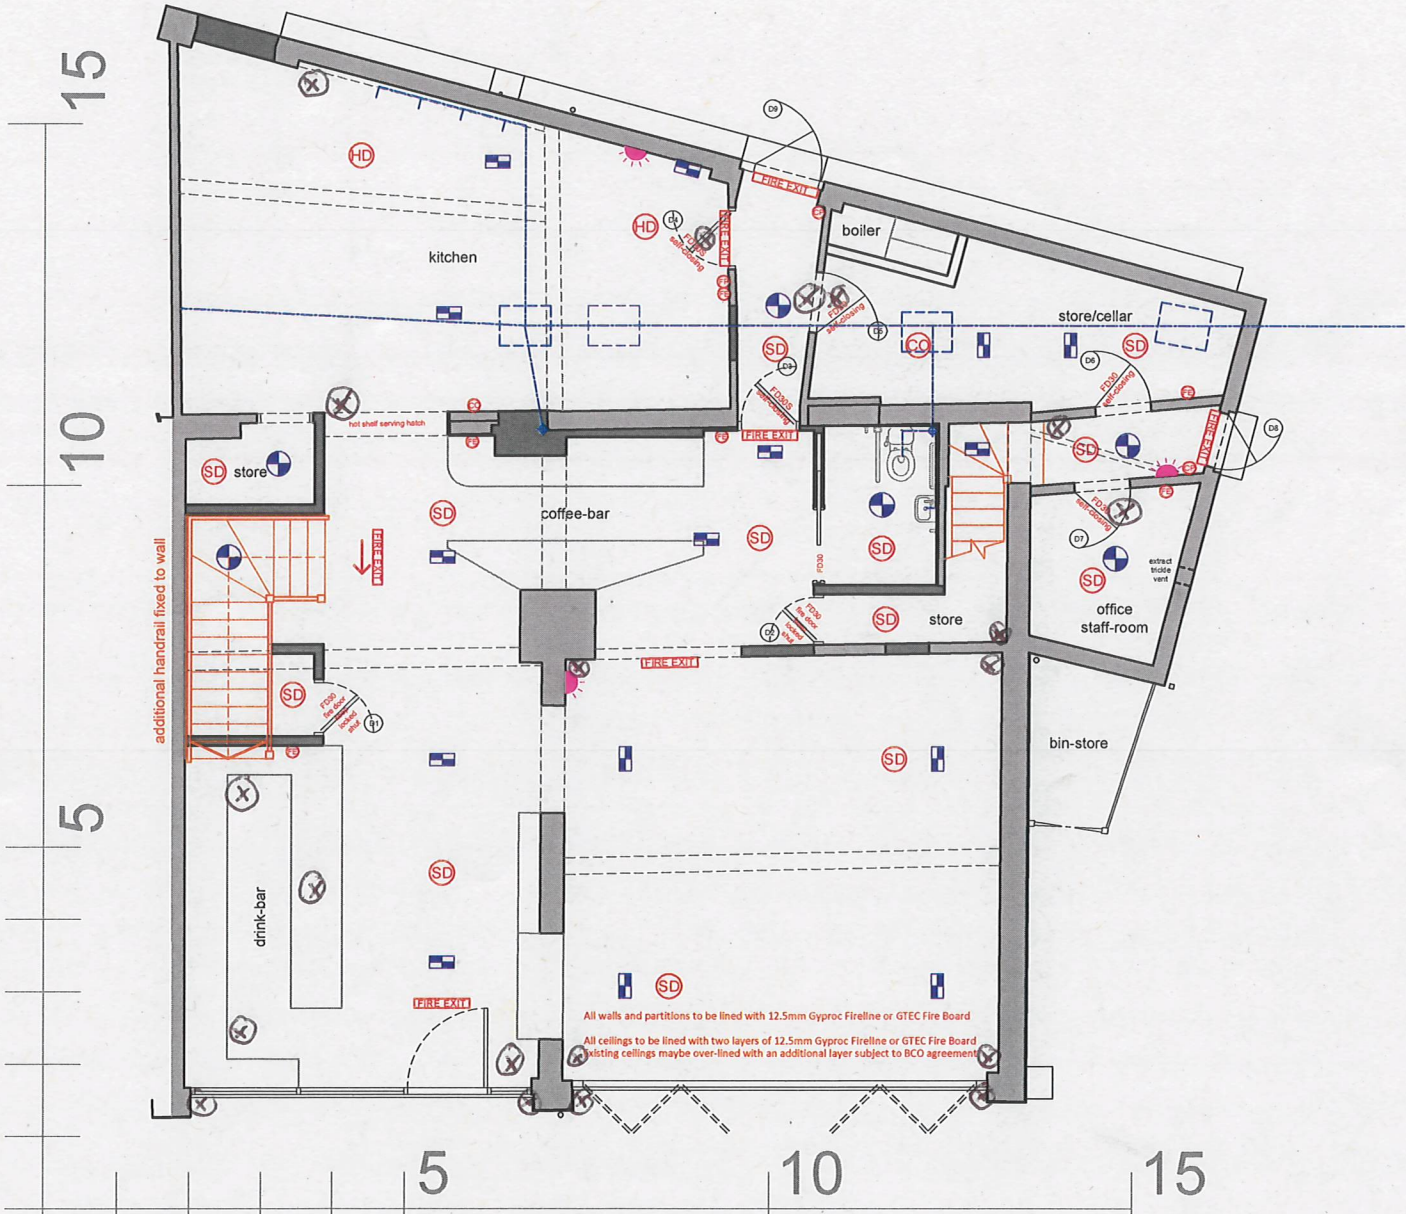

2210-5F - ground floor plan 1/50 @ A2
 The Westfield, 46-48 Westfield Road, Westfield, Woking, Surrey. GU22 9NG

A T Design

34 Alexandra Gardens
Knaphill
Woking
Surrey
GU21 2DG

M: 07411 235088
E: a-t-design@outlook.com

BS 5839-1:2017 Fire detection and fire alarm systems for buildings
Part 1: Code of practice for design, installation, commissioning, and maintenance of systems in non-domestic premises.

BS 5839-2:1983 Fire detection and alarm systems for buildings
Part 2: Specification for manual call points

BS 5266-1:2016 Emergency lighting
Part 1: Code of practice for the emergency lighting of premises


BS 5499-4:2013 Safety signs
Part 4: Code of practice for escape route signing


BS 5499-5:2002 Graphical symbols and signs
Part 5: Safety signs, including fire safety signs

BS EN 14604:2005 Smoke alarm devices


BS 7671:2018 Requirements for Electrical Installations.
IET Wiring Regulations 18th Edition


Approved Document B (fire safety) volume 2:
Buildings other than dwellings,
2019 edition incorporating 2020 and 2022 amendments


 alarm sound/light


 fire call-point


 fire extinguisher

 small emergency light

 large emergency light

 smoke detector


 heat detector

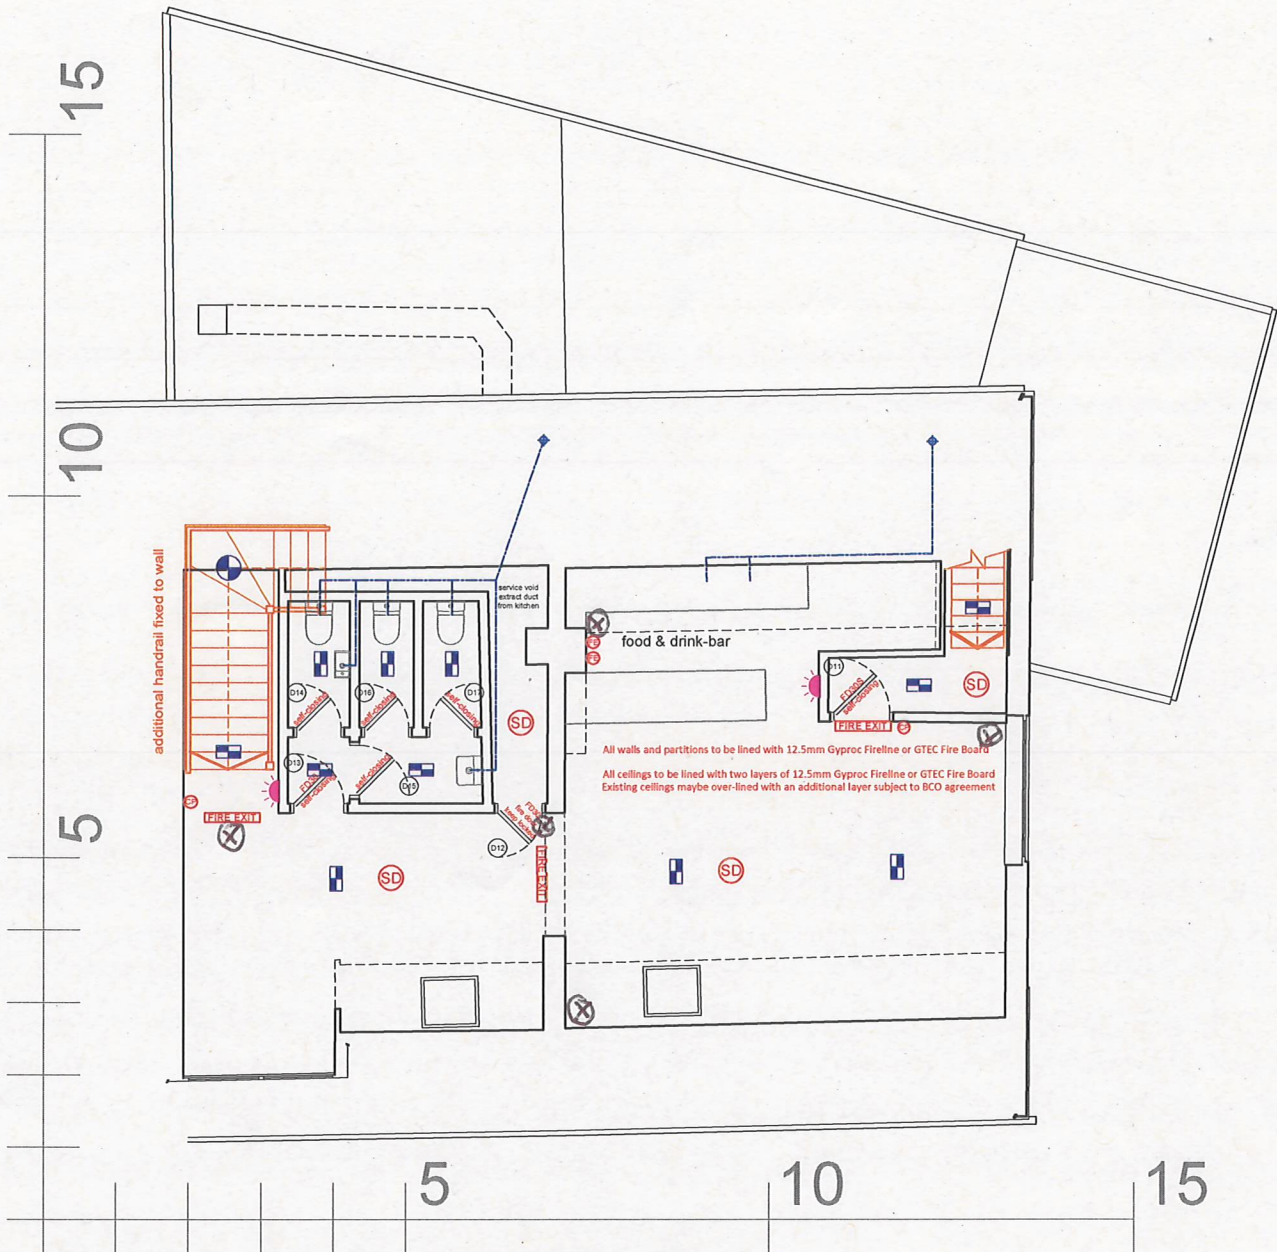

2210-6D - first floor plan 1/50 @ A2

The Westfield, 46-48 Westfield Road, Westfield, Woking, Surrey. GU22 9NG



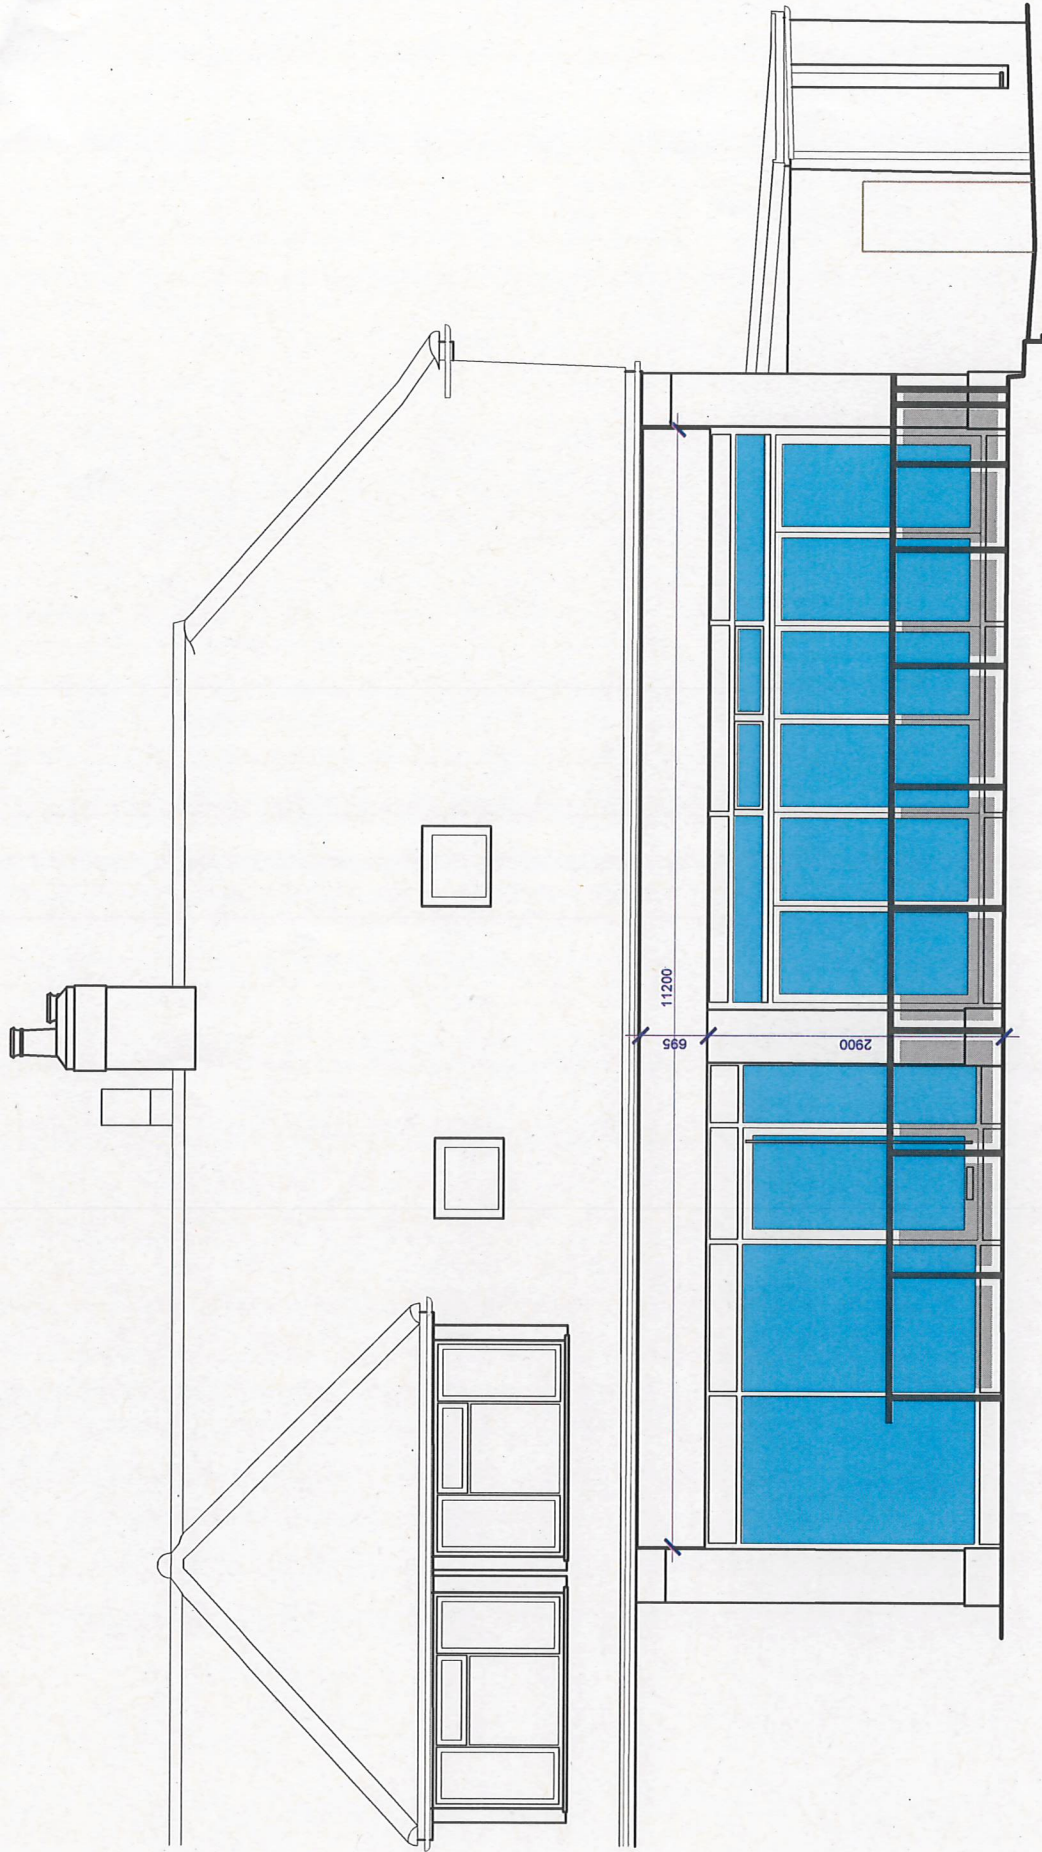

Front Elevation

Datum 49.00m